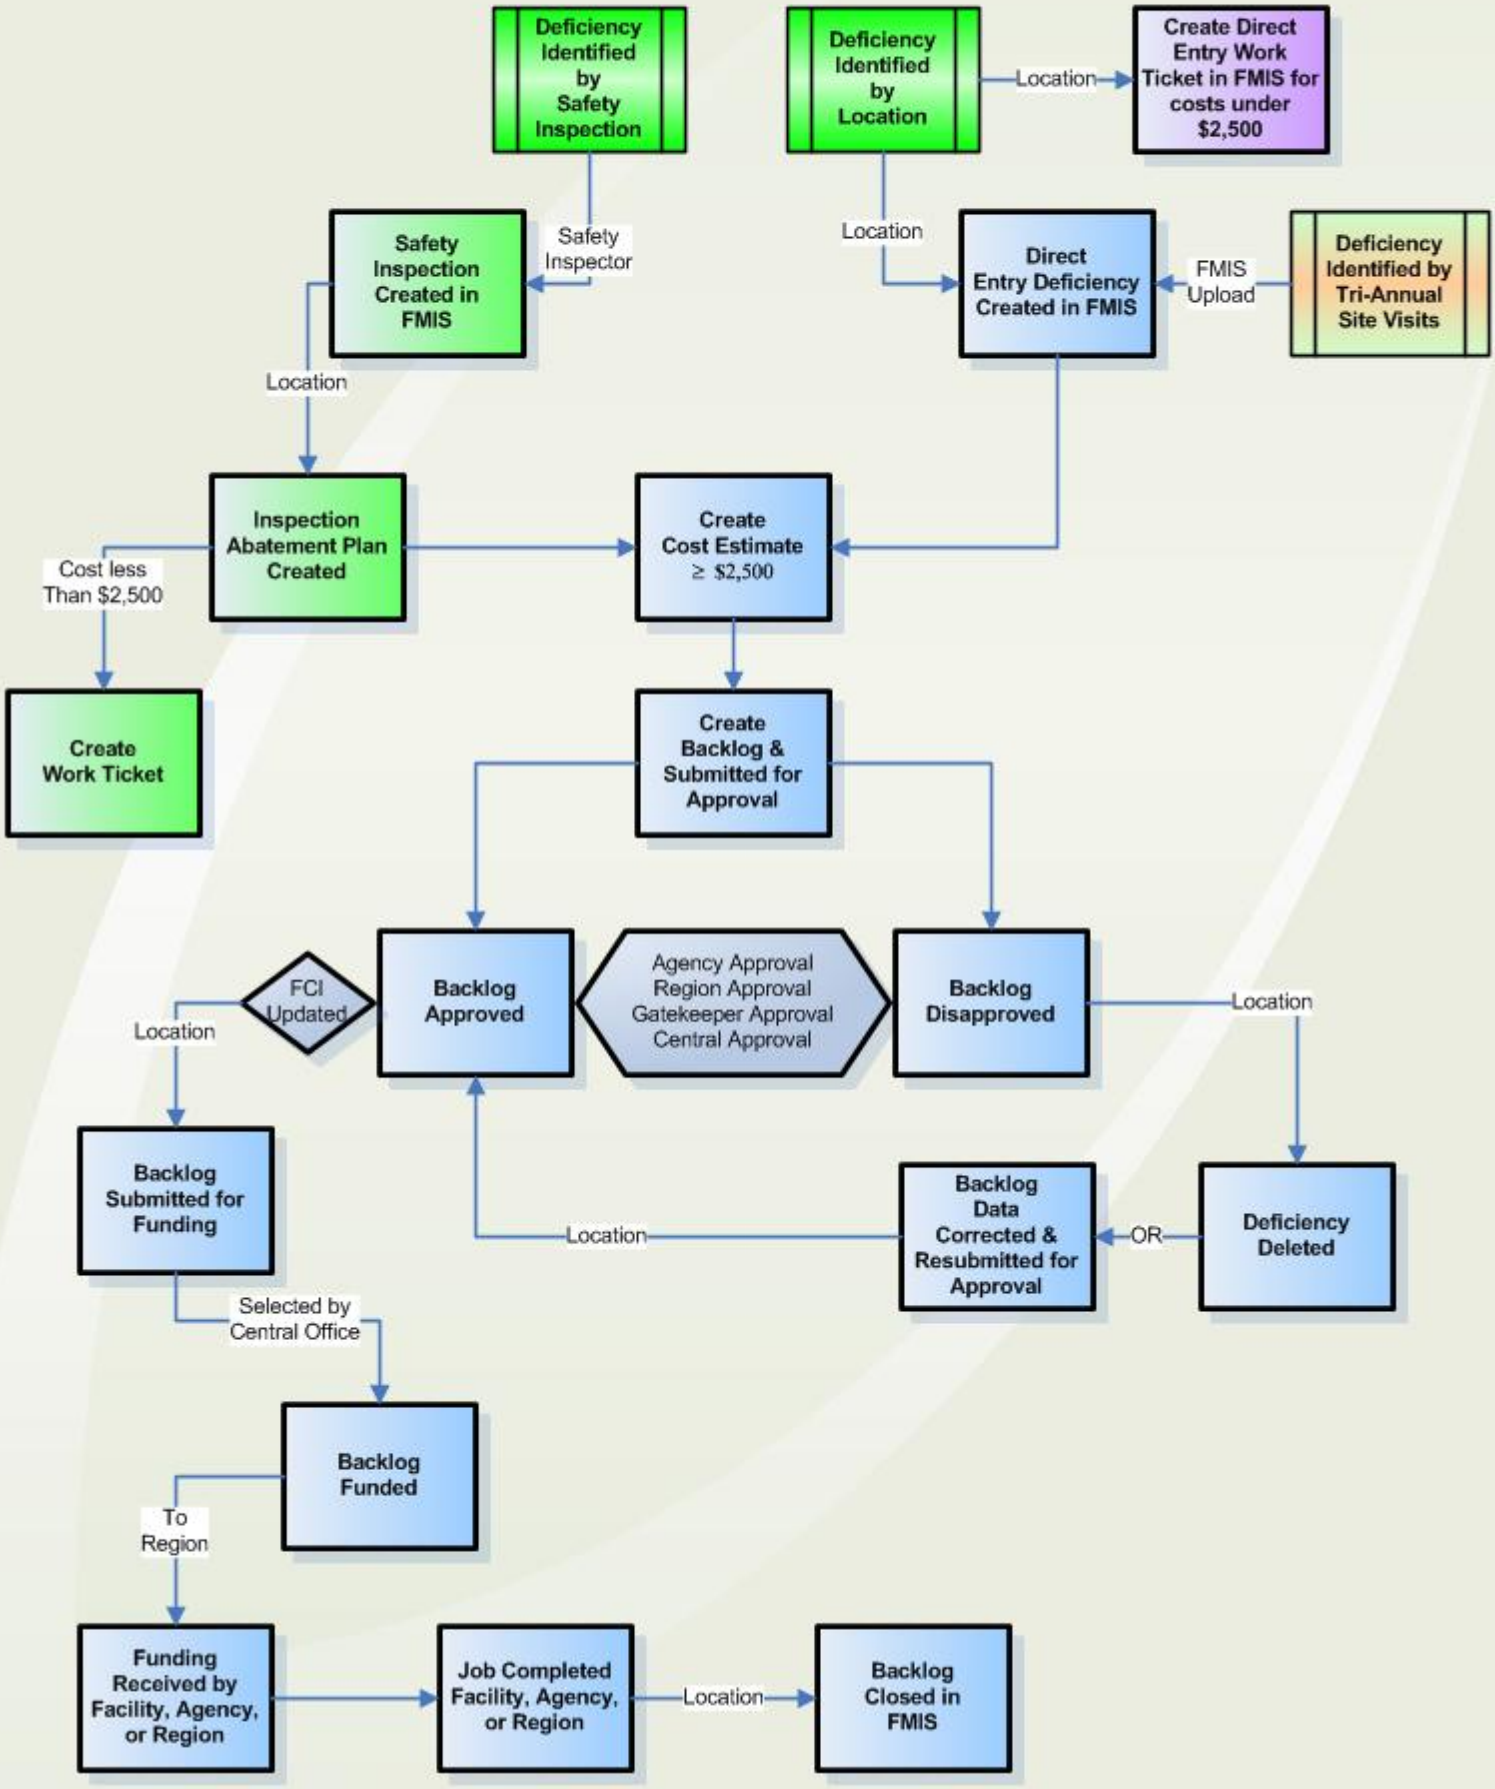Facility Deficiency Flow Diagram